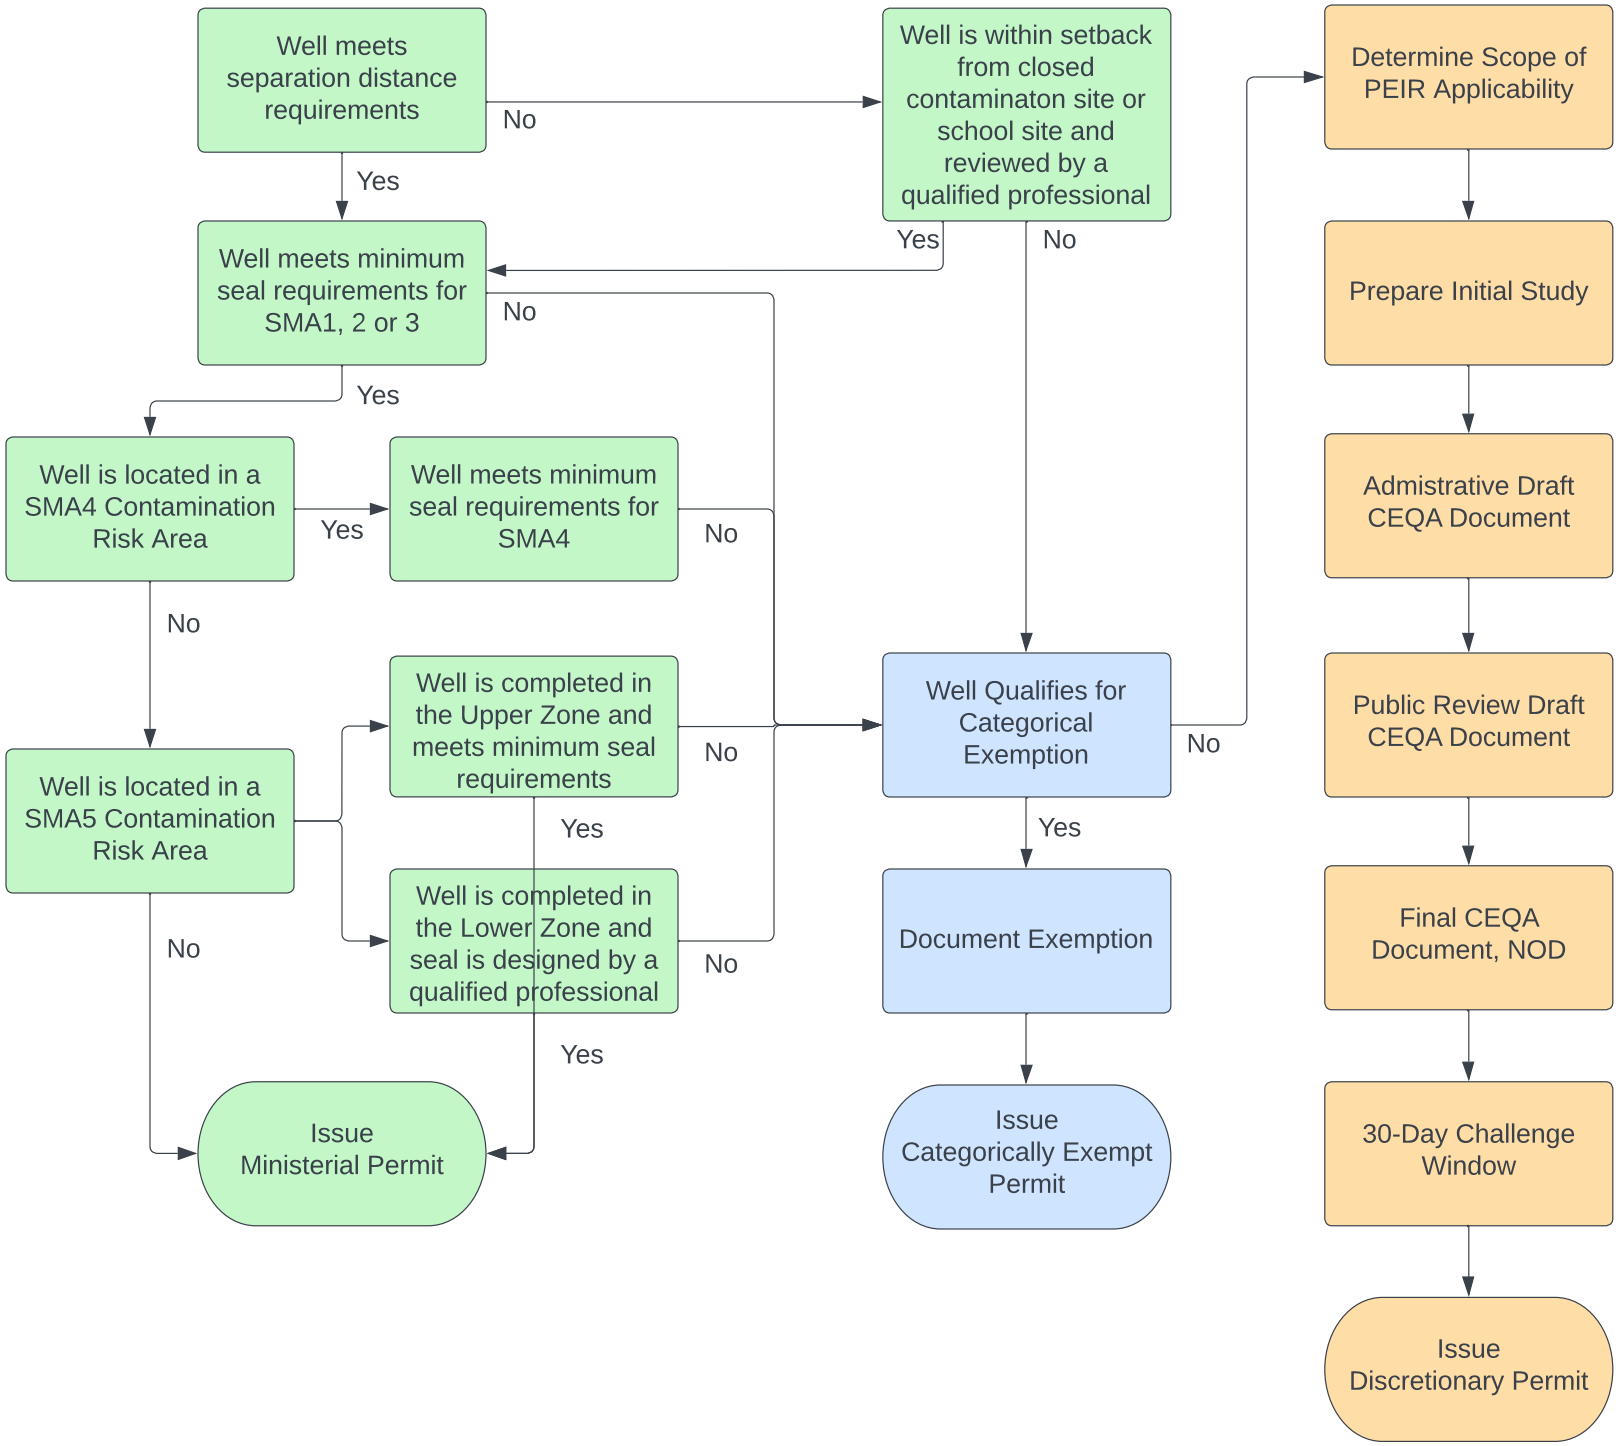
Well meets separation distance requirements
No
Yes
Well is within setback from closed contaminaton site or school site and reviewed by a qualified professional
Yes
No
Well meets minimum seal requirements for SMA1, 2 or 3
No
Yes
Well is located in a SMA4 Contamination Risk Area
Yes
Well meets minimum seal requirements for SMA4
No
No
Well is located in a SMA5 Contamination Risk Area
Well is completed in the Upper Zone and meets minimum seal requirements
No
Yes
Well is completed in the Lower Zone and seal is designed by a qualified professional
No
Yes
No
Issue Ministerial Permit
Well Qualifies for Categorical Exemption
No
Yes
Document Exemption
Issue Categorically Exempt Permit
Determine Scope of PEIR Applicability
Prepare Initial Study
Admistrative Draft CEQA Document
Public Review Draft CEQA Document
Final CEQA Document, NOD
30-Day Challenge Window
Issue Discretionary Permit